Coolmay®
Automation Expert

L02S Series AIO Module User Manual

Thank you for purchasing Coolmay L02S series AIO modules. This manual mainly describes the product characteristics, general specifications and wiring methods of the module. For detailed usage, please refer to "Coolmay L02S Series PLC Programming Manual".

L02S series AIO modules have the following characteristics:

1. Used with Coolmay L02S series CPU, the address is automatically assigned.
2. Standard DIN rail (35mm wide) and snap-in buckle installation, convenient installation and removal.
3. Using push-type terminals, convenient wiring.

◆ Product Structure


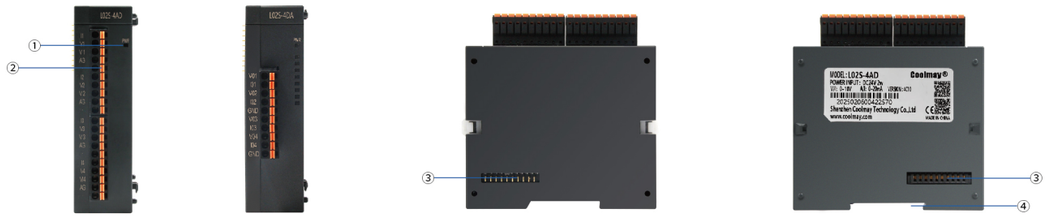


Figure 1 Product structure

1. PWR: power indicator
2. Analog input and output terminal block
3. Expansion interface
4. Standard DIN rail installation

◆ Hardware Port

Analog input module




4 point
Analog input/ Current and voltage
L02S-4AD

Analog output module



4 point
Analog output/ Current and voltage
L02S-4DA

Analog input/ output module




4/2 point
Analog input/output Current and voltage
L02S-4AD2DA

Temperature analog module



4 point	4 point	4 point
Temperature sensor/ PT100/PT1000	Temperature sensor/ Thermocouple	Temperature sensor/ NTC10K
L02S-4RTD	L02S-4TC	L02S-4NTC

Weighing module



Basic function	
50/60Hz filter	High-speed dynamic weighing
Dual channel independent sampling	Rated weight 0.4%
2 sets of channels	4-wire Load Cell

2 point
Weighing module
L02S-2LC

Figure 2 AIO module

AIO Module size

L02S-4AD、L02S-4DA、L02S-4AD2DA
L02S-4RTD、L02S-4TC、L02S-2LC

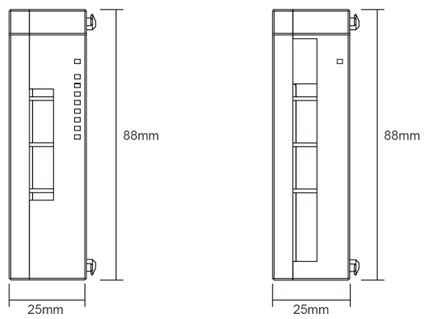


Figure 3 Dimensions of AIO module

◆ Installation Notes

Snap-in buckle installation method

Open the white buckle, align the expansion interface and push the module directly in, press the white buckle at both ends to complete the installation.




Arrange the modules neatly　Push modules　Press the buckle

Figure 4 Snap-in buckle installation

Rail installation method

The CPU module and each expansion module can be directly installed on the standard rail DIN35mm without a backplane; the product can be directly locked on the rail by pressing the rail buckle....

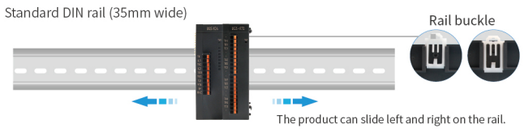

Put the module into the rail card slot, press the rail buckle to complete the installation.


Figure 5 Rail installation

◆ Analog Wiring

The L02S series analog modules have the following wiring methods. Please do not wire the empty terminals.

Current and voltage


1. Please use insulated wires for analog input/output signals and separate them from other power cables.
2. If the current signal is connected, the Vn and In (n=1~4) terminals must be short-circuited.

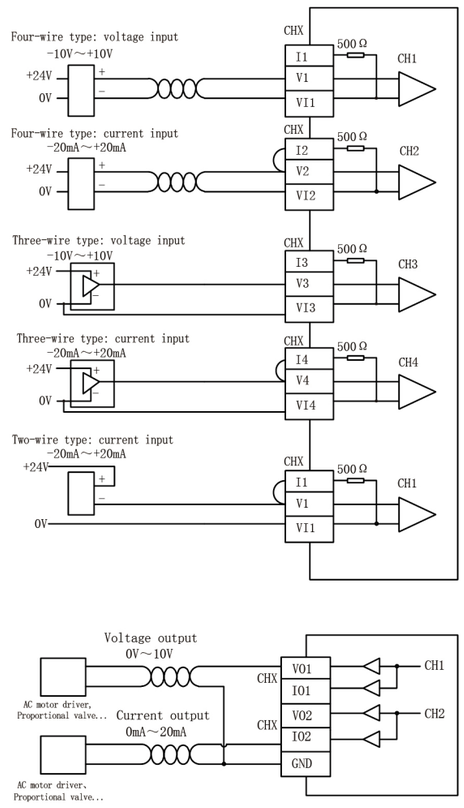

RTD


1. Use insulated twisted-pair wires to reduce interference. Be careful to keep them away from other power cables or wires that may cause noise.
2. When using 2-wire temperature sensor, please short-circuit TBn and TCn (n=1~4).

Note: The length of the three-wire type wire must be equal, the single wire length is less than 200m and the single wire resistance is less than 20ohm.

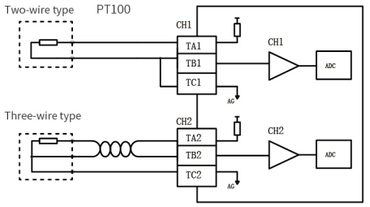


TC

Use J, K, S, T, E type thermocouple temperature sensor connection wires or insulated twisted-pair wires, and separate them from other power cables or wires that may cause noise.

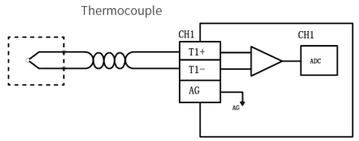

NTC

When using thermistor, pay attention to the B value of the sensor, NTC10K (B value defaults to 3435);

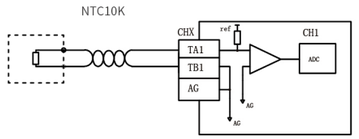

Weighing module L02S-2LC

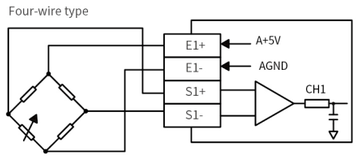


Figure 6 Analog wiring diagram

2026/04

The model specifications and information of the products in this manual are subject to change without prior notice